


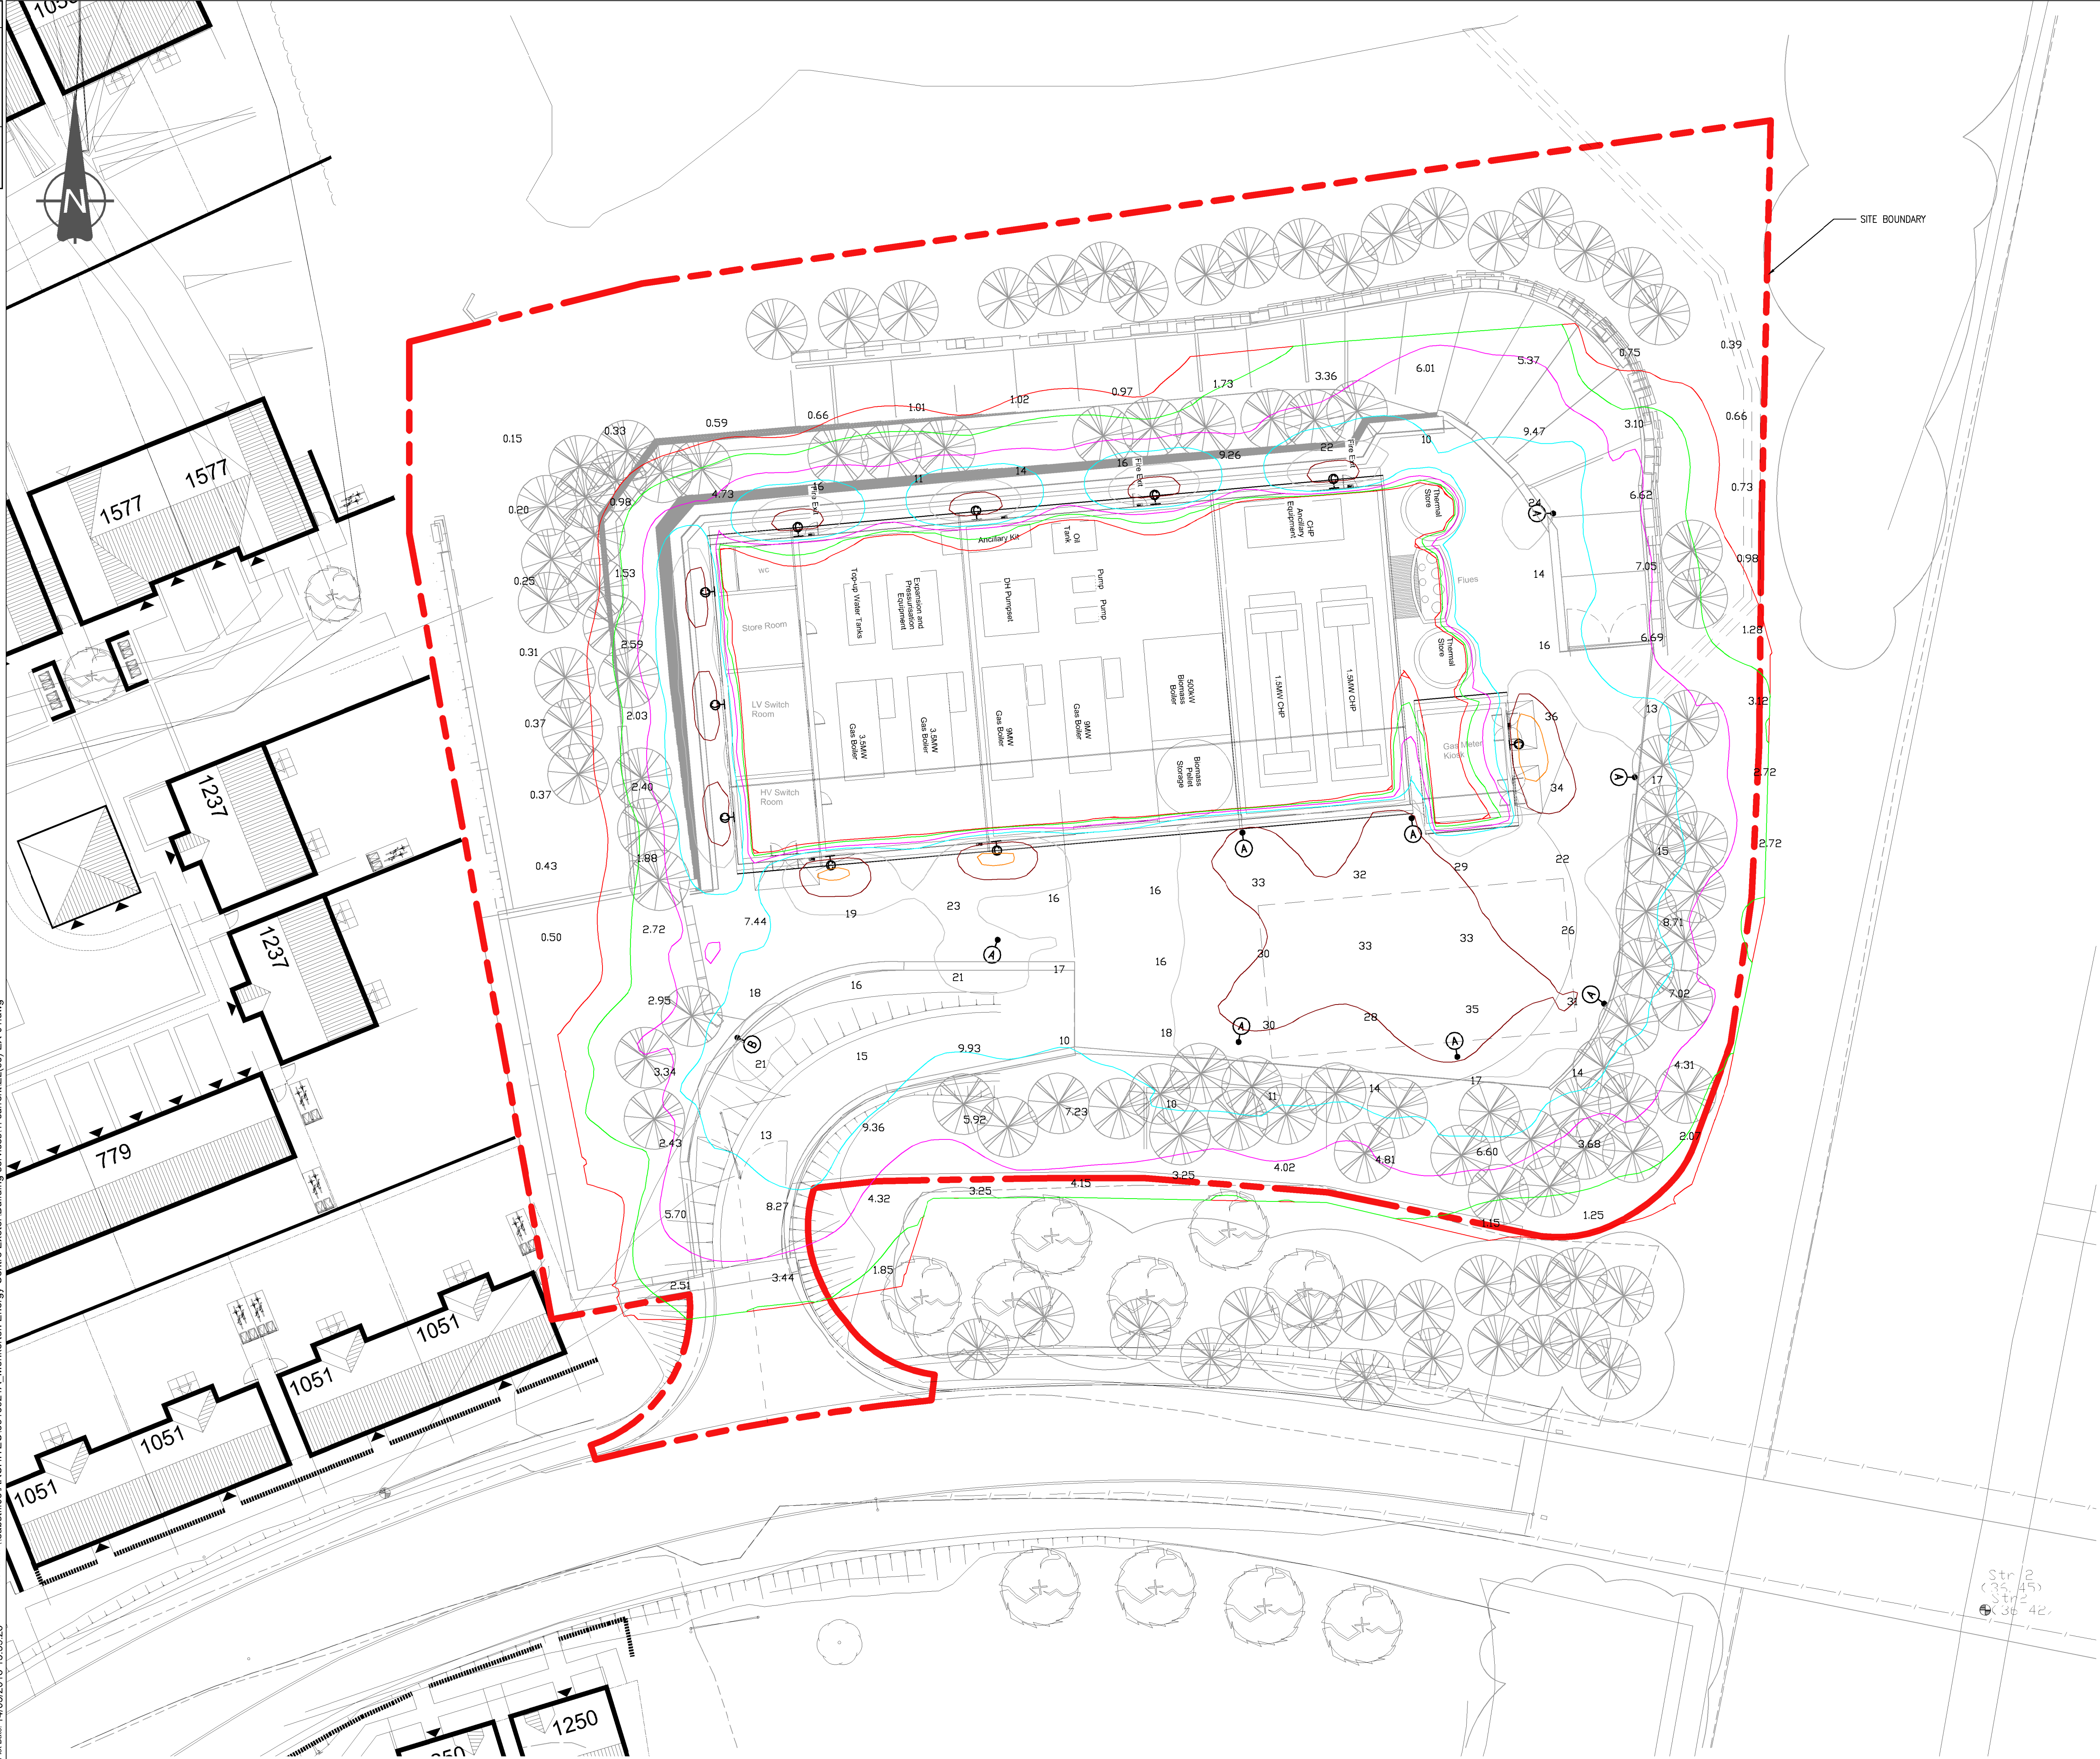

- NOTES**
- LIGHTING HAS BEEN DESIGNED IN COMPLIANCE WITH THE FOLLOWING STANDARDS:
 - BS EN 12464-2:2014 OUTDOOR WORKPLACES
 - BS 5489-1:2013 CODE OF PRACTICE FOR DESIGN OF ROAD LIGHTING
 - SLL CODE FOR LIGHTING
 - LUMINARIES TO BE EVALUATED AGAINST FITTED.

SYMBOL	IMAGE	DESCRIPTION
A		5 METER POLE MOUNTED HOLOPLANE D-SERIES DSX1 FORWARD LED LUMINAIRE IP65
B		5 METER POLE MOUNTED HOLOPLANE D-SERIES DSX1 ASYMMETRIC LED LUMINAIRE IP65
Q		WALL MOUNTED HOLOPLANE DENVER ELITE WALL LED LUMINAIRE IP65

ISOLINES	LUX AT GROUND LEVEL
1.0 lx	1.0 lx
2.0 lx	2.0 lx
5.0 lx	5.0 lx
10.0 lx	10.0 lx
20.0 lx	20.0 lx
30.0 lx	30.0 lx
40.0 lx	40.0 lx

P04	09/03/16	Development added, Effect evaluated	DF	MM	MM
P03	16/12/15	Revised Issue for new Layout	DF	MM	MM
P02	16/09/15	Issued for Planning	DF	MM	MM
P01	12/08/15	First Issue	DF	MM	MM
Rev	Date	Description	By	Chk	App

ISSUE FOR PLANNING

Kings Orchard
1 Queen St
Bristol BS2 0HQ

Tel: 44-(0)117-930-6200

Client:
EON

Site/Project:
MONKERTON
ENERGY CENTRE

Title:
EXTERNAL LIGHTING

Drawn: DAVID FORSHAW
Designed: DAVID FORSHAW
Date: 25/08/2015
Project Number: 3513921A-BAR

Checked: MARK MCGARRITY
Approved: MARK MCGARRITY
Scale: 1:200
Drawing Number: EL(63)-EX-01

Sheet: 1 OF 1
Revision: P04

© Copyright Parsons Brinckerhoff